



Bath County Health Department
P. O. Box 120
Warm Springs, Virginia 24484
(540) 839-7246 Voice
(540) 839-2964 Fax

Sewage Disposal System Operation Permit

Property Owner

Elkhorn Inc.
Rt 1 Box 57
Millboro, Virginia 24460
Phone: (540) 939-4242

Health Dept. ID: 108-06-0014

Tax Map: 77-3-5

Locality: Bath

Property Location

Property Address: Ridge Road
Millboro, Virginia 24460

Directions:

Elkhorn Inc. is hereby granted permission to operate a SE - Drip (GMP #107) Sewage System at the above referenced location, having a design capacity of 900 gallons per day, or 6 bedrooms maximum.

This permit is issued in accordance with the provisions of Title 32.1, Chapter 6 of the Code of Virginia as Amended, and Section 12VAC 5-610-340 of the Sewage Handling and Disposal Regulations of the Virginia Department of Health. The issuance of an operation permit does not denote or imply any guarantee by the department that the sewage disposal system will function for any specified period of time. It shall be the responsibility of the owner or any subsequent owner to maintain, repair, or replace any sewage disposal system that ceases to operate in accordance with the regulations.

April 25, 2007
Effective Date

John Burch
EHS


Signed May 2, 2007

198 LIGESIA3 DRIVE
6 Bedroom Drip system



BLACKWELL ENGINEERING, PLC

566 E. MARKET ST. • HARRISONBURG, VIRGINIA 22801 • (540) 432-9555 • FAX (540) 434-7604

April 25, 2007

Mr. John Burch
VDH-Bath County
Court House Square
P.O. Box 120
Warm Springs, VA 24484

RECEIVED
APR 25 2007
BATH COUNTY
HEALTH DEPARTMENT

Ref: Kevin Armstrong for Egelesiea, FAST ATU, to a Drip Irrigation Disposal
BE: 5773-06 HD#: Tax Map#: 77-0-5

Dear Mr. Burch:

I am pleased to inform you that the FAST ATU, to a Drip Irrigation Disposal, installed by Steve Armstrong – General Contractor, inspected by Blackwell Engineering was started up on April 24, 2007, and is functioning as designed. The system is now in the automatic mode and is capable of receiving wastewater flows.

I hereby certify that the alternate onsite system has been substantially installed and completed in accordance with the project plans and specification on which the construction permit was issued. I recommend that an operation permit be issued for this system.

Sincerely,

Richard L. Blackwell, III, P.E.
Environmental Engineer

cc: to owner

Completion Statement

Commonwealth of Virginia
State Department of Health

Health Department
Identification Number 108-06-7004

Batg Light Co.

Health Department

Name of Company/Corporation/Individual: Armstrong Backhoe Svc

Address: _____ Telephone: _____

Owner's Name Jose Iglesias

Owner's Address 1000 Brickell Ave. #630, Miami FL 33131

Location of Installation: Lot _____ Block _____

Section: _____ Subdivision: _____

Other: TM 77-365

I hereby certify that the onsite sewage disposal system has been installed and completed in accordance with the construction permit issued (date) 5-10-06 and is in compliance with Part D of the Sewage Handling and Disposal Regulations and when appropriate the plans and specifications for the project.

4-24-07

Date

Steve B. Armstrong

Signature and Title

Schematic drawing of sewage disposal and/or water supply system and topographic features.

Show the lot lines of the building site, sketch of property showing any topographic features which may impact on the design of the well or sewage disposal system, including existing and/or proposed structures and sewage disposal systems and wells within 200 feet. The schematic drawing of the well site or area and/or sewage disposal system shall show sewer lines, pretreatment unit, pump station, conveyance system, and subsurface soil absorption system, reserve area, etc. When a nonpublic drinking water supply is to be permitted, show all sources of pollution within 200 feet.

☐ The information required above has been drawn on the attached copy of the sketch submitted with the application.
Attach additional sheets as necessary to illustrate the design.

Install, Operate, and Maintain sewage treatment and disposal system in accordance with plans and specifications:

*Prepared by: Blackwell Engineering
Blackwell Project # 5773-06*

*Titled:
Engineering Design Manual
for*

*K. Armstrong for Egelesia
Fast ATU,
To a Drip Irrigation Disposal*

*Contact information
Roger Burnett
Blackwell Engineering
566 East Market Street
Harrisonburg VA 22801*

PH# 540-432-9555

This sewage disposal system and/or water supply is to be constructed as specified by the permit _____ or attached plans and specifications X.

This sewage disposal system and/or well construction permit is null and void if (a) conditions are changed from those shown on the application (b) conditions are changed from those shown on the construction permit.

No part of any installation shall be covered or used until inspected, corrections made if necessary, and approved, by the local health department or unless expressly authorized by the local health dept. Any part of any installation which has been covered prior to approval shall be uncovered, if necessary, upon the direction of the Department.


Date: 5-10-06 Issued by: [Signature]
Sanitarian

Date: _____ Reviewed by: _____
Supervisory Sanitarian

This Construction
Permit Valid until
11-10-2007

If FHA or VA financing

Reviewed by Date: _____ Date: _____
Supervisory Sanitarian Regional Sanitarian

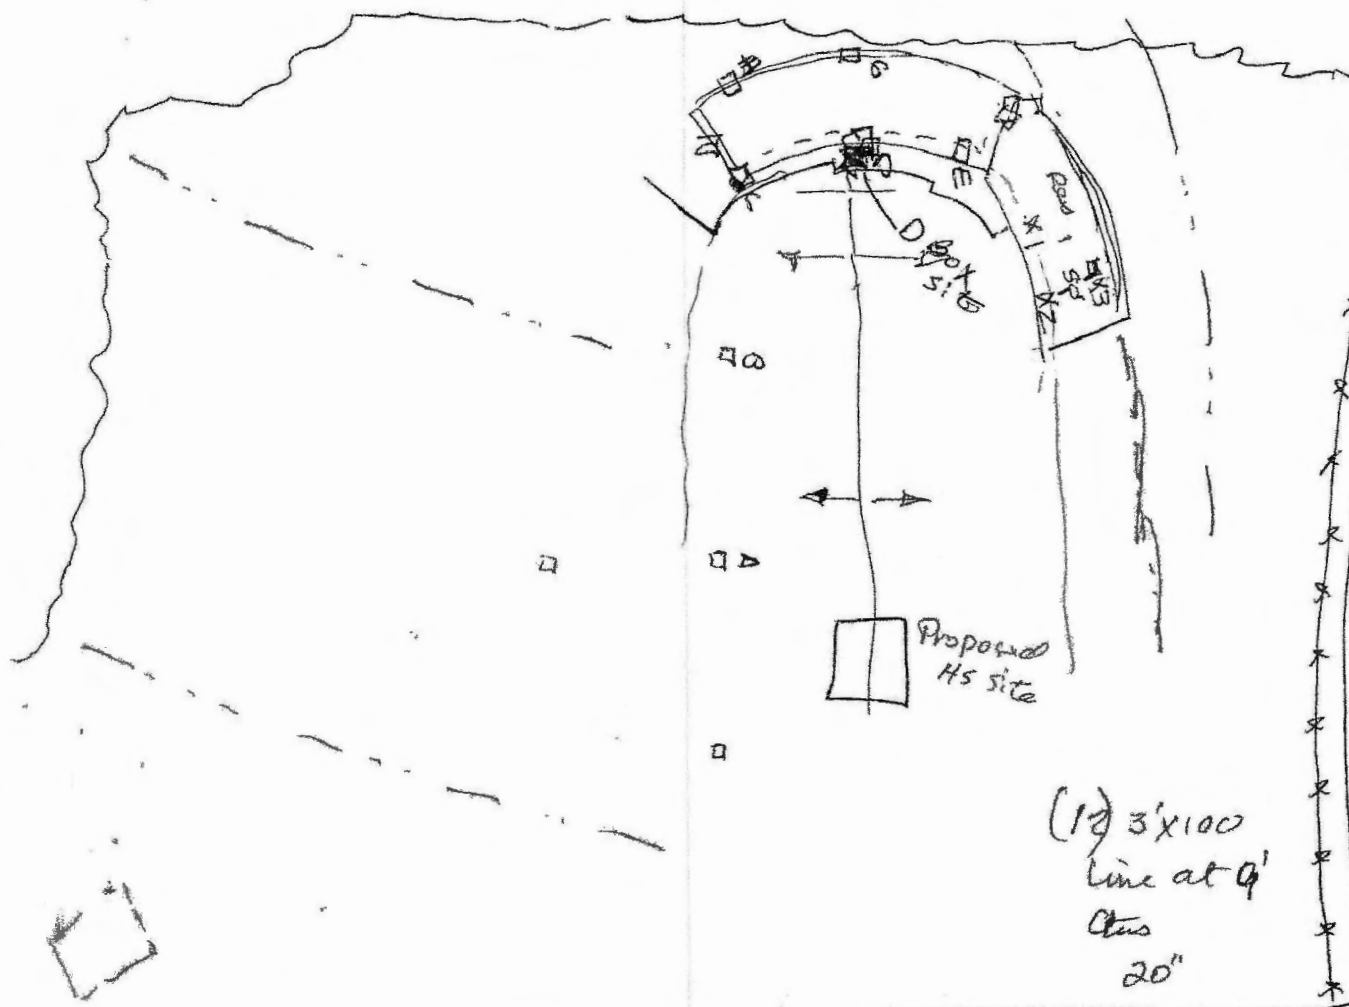

(12) 3' x 100'
line at 9'
plus
20"

Pump Sys

5BR
750

~~TH 406~~

14 90^o Cêus

